

## Installation at Sir Ganga Ram Hospital


Delhi

- Peak requirement of 3000 liters hot water per hour at 60°C
- Installed 180 kW Heating Capacity
- COP 4
- Savings of 1080 kW of unit per day
- ROI of 6 months when calculated taking into consideration of depreciation benefit .

### 1) Heat Pumps



## 2 )Schematic Drawing

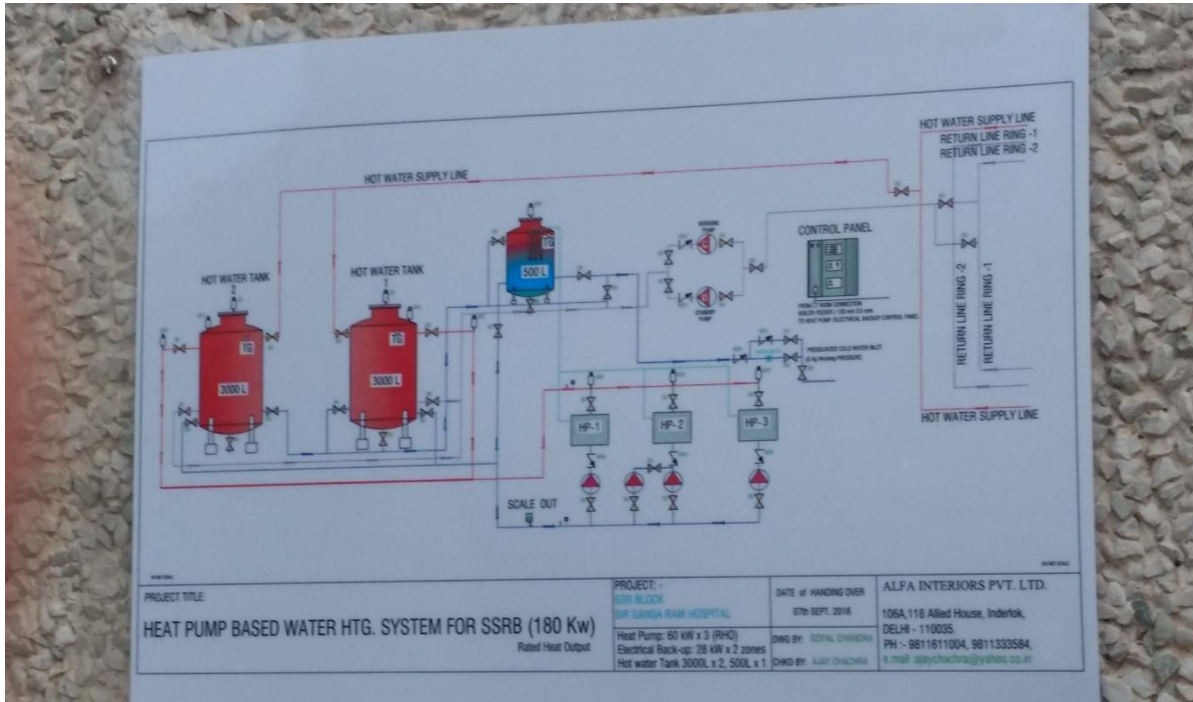

## 3) Tanks



## 4) Plumbing

